


JORDAN WATER
INFRASTRUCTURE TASK 1

AQABA-AMMAN
WATER DESALINATION AND
CONVEYANCE PROJECT

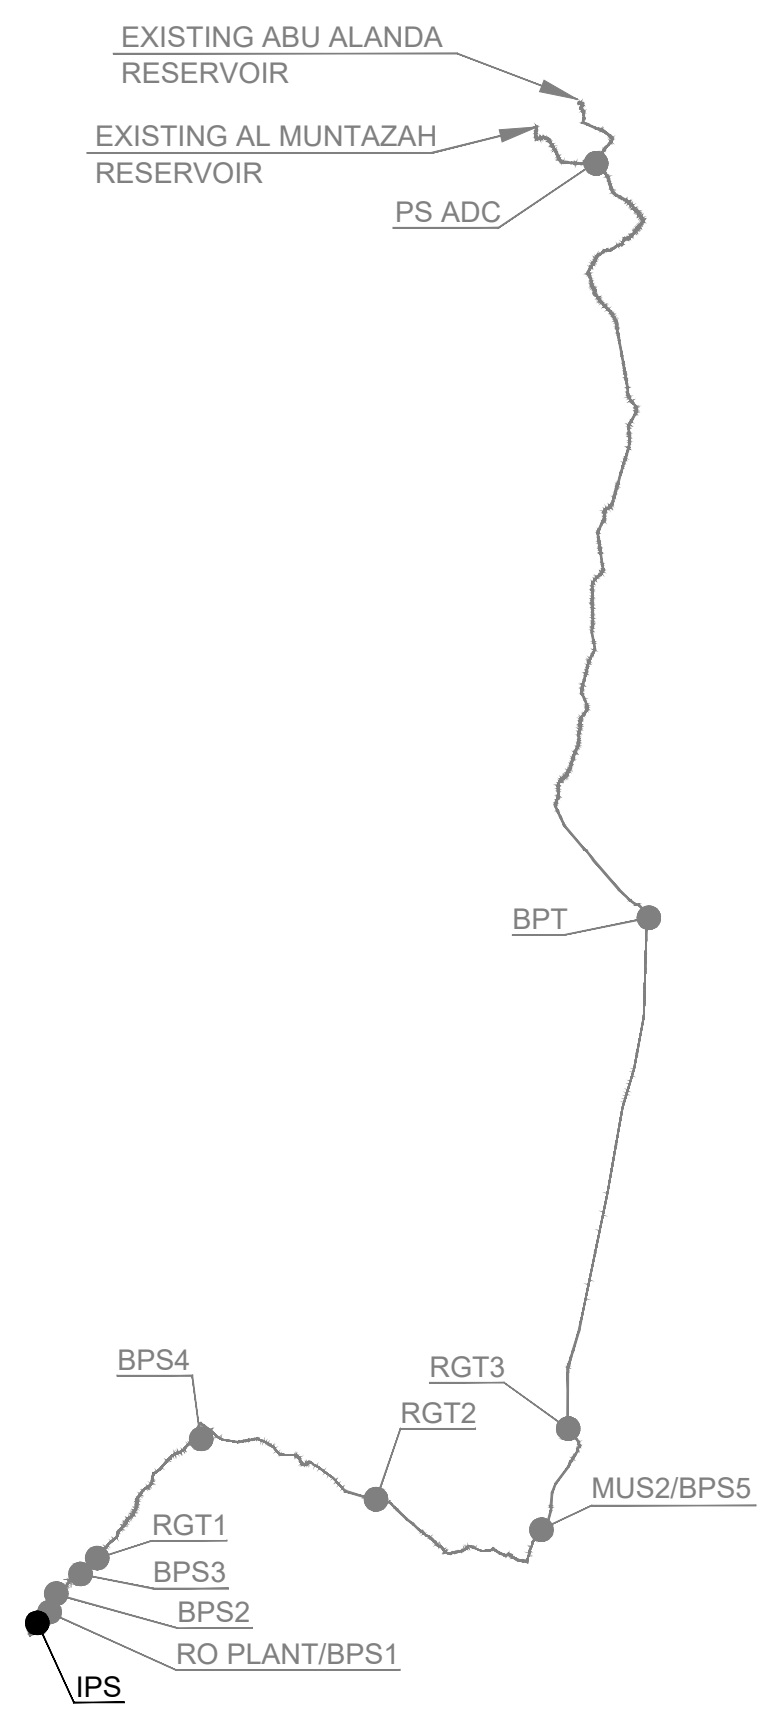

- Notes
1. ALL DIMENSIONS ARE IN METERS AND PIPE DIAMETERS ARE IN INCHES UNLESS OTHERWISE INDICATED.
 2. SITE COORDINATES ARE IN JORDAN TRANSVERSE MERCATOR PROJECTION SYSTEM.
 3. PIPES MATERIALS ARE AS SHOWN ON THE DRAWING.
 4. FOR IPS PUMP STATION DETAILS REFER TO DRAWINGS NO. J19092-0100D-PD-MI-101 AND J19092-0100D-PD-MI-301.
 5. FOR IPS ELECTRICAL BUILDING DETAILS REFER TO DRAWINGS NO. J19092-0100D-PD-E-100.
 6. FOR PIPE TRENCH DETAILS REFER TO DRAWINGS NO. J19092-0100D-PD-ENV-WW-501.
 7. FOR BUTTERFLY VALVE AND FLOW METER CHAMBER DETAILS REFER TO DRAWINGS NO. J19092-0100D-PD-ENV-WW-502 AND J19092-0100D-PD-ENV-WW-504 RESPECTIVELY.
 8. THE MINIMUM WATER LEVEL IN ACCESS MANHOLE 2 SHOULD BE 5m.

PRELIMINARY DESIGN
AUGUST 2021

PREPARED BY:
CDM INTERNATIONAL
DAR AL HANDASAH CONSULTANTS
(Shair & Partners)

Rev	Date	Description	Approved
3	20/08/2021	GENERAL REVISION	B.H
2	15/06/2021	GENERAL REVISION	B.H
1	10/05/2021	GENERAL REVISION	B.H
0	12/04/2021	APPROVED ISSUE	B.H

REVISIONS			
Drawing Title:			
INTAKE PUMPING STATION IPS SITE LAYOUT PLAN			
Drawn by	Designed by	Checked by	Approved by
M.A	J.K	N.A	B.H
Scale: 1/350	Size: A0	Date: APRIL 2021	
DRAWING NO			REV
J19092-0100D-PD-ENV-WW-101			3