


40m DLS R.O.W

LOCATION OF THE PIPES WITH RESPECT OF THE ROAD




JORDAN WATER
INFRASTRUCTURE TASK 1

AQABA-AMMAN
WATER DESALINATION AND
CONVEYANCE PROJECT

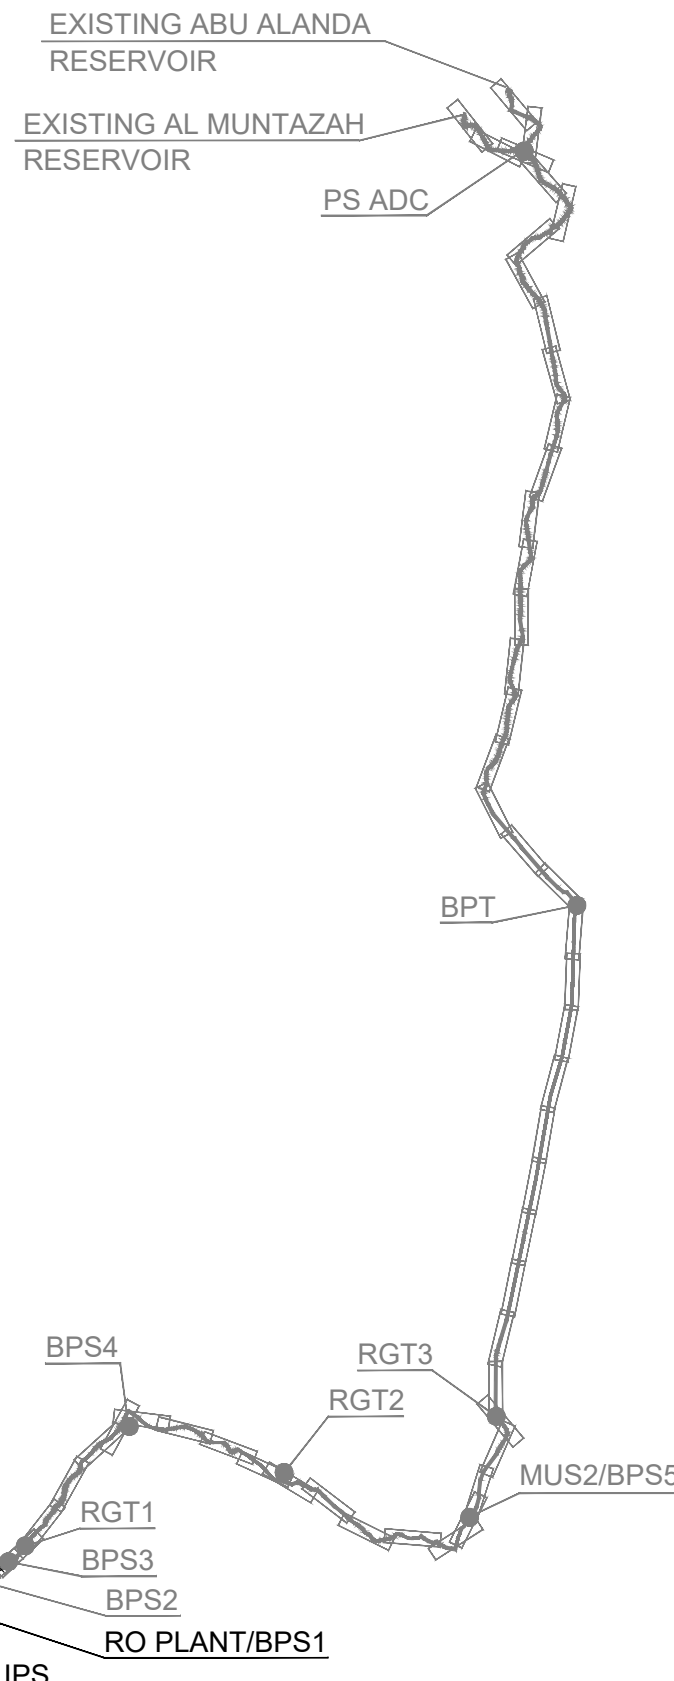

- Notes
- EXACT LOCATION OF AIR VALVES AND WASHOUT VALVES SHALL BE VERIFIED AT DETAILED DESIGN STAGE BASED ON FINAL PIPELINE PROFILES. INTERMEDIATE AIR VALVES WILL BE REQUIRED TO LIMIT SPACING ALONG ASCENTS/DESCENTS TO 1.2 km.
 - BETWEEN STATION 2+500 AND 3+000, THE PIPE RUNS ALONG A PLANNED ROAD OF WHICH THE EARTH WORKS WILL BE EXECUTED BEFORE LAYING THE PIPE
 - PROVIDE ACCESS MANHOLE AT 250M SPACING OR AS APPROPRIATE TO FACILITATE THE MANUAL CLEANING

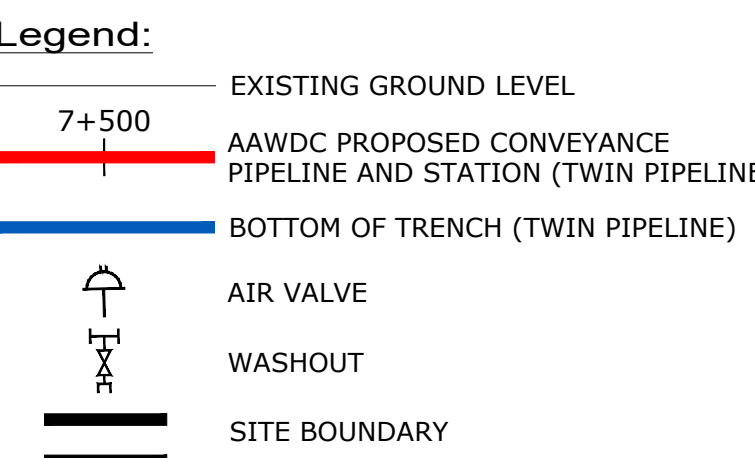

PRELIMINARY DESIGN
JUNE 2021

PREPARED BY:
CDM INTERNATIONAL
DAR AL HANDASAH CONSULTANTS
(Shair & Partners)

Rev	Date	Description	Approved
1	23/06/2021	GENERAL REVISION	B.H
0	12/04/2021	APPROVED ISSUE	B.H

REVISIONS			
Drawing Title:			
FROM IPS TO RO PLANT SEA WATER PIPES PLAN AND PROFILE FROM Sta. 0+000 TO Sta. 3+452 SHEET 1 OF 1			
Drawn by	Designed by	Checked by	Approved by
A.F	R.F	N.A	B.H
Scale: H: 1/5,000 V: 1/500	Size: A0	Date: APRIL 2021	REV
DRAWING NO			REV
J19092-0100D-PD-ENV-VW-401			1